

Barossa Infrastructure Limited Recycled Water Irrigation Scheme Annual Recycled Water Quality Monitoring Report 2020-2021

Premises details	
Name of premises:	Barossa Infrastructure Limited Recycled Water Irrigation Scheme
Type of premises:	Other Water utility supplying to vineyards
Premise address	
Owner details BAROSSA INFRASTRUCTURE LTD ABN: 80084108958 ACN: 084108958 Australian Public Company 5352 SA	
Primary contact person: Simon Schutz General Manager Barossa Infrastructure Limited 0403 743 199 simon@BIL.net.au	Secondary contact person: Neville Skipworth Operations Manager Barossa Infrastructure Limited 8563 2300 Neville@bil.net.au

Water quality monitoring and system performance			
On-site wastewater system details			
Method of treated wastewater disposal or re-use:		Irrigation via surface drippers	
The treated wastewater is irrigated to:		Vineyard	
Average total daily flow into the system (L):		Total annual volume of wastewater generated by the premises (kL):	
The system is operated and maintained by: Barossa Council Michael Clark Co-ordinator Community Wastewater Management Systems 8563 8479 mclark@barossa.sa.gov.au		Third-party contractor	
Servicing details			
Is the system serviced on a regular basis		Yes	

OFFICIAL

Servicing frequency		Weekly		
The system is serviced by: Infrastructure Maintenance Services Steve Dewar Director stevedewar@imssa.net.au 0418845738 (if blank, servicing undertaken by third-party operator or not serviced)				
Water quality monitoring				
Method of supplying water quality results		Attach summary		
Sample Date		Suspended Solids (mg/L)	E.coli (org/100mL)	
Has the required sampling frequency been achieved?		Yes		
Have any results exceeded the required parameters?		Yes The water quality data is 'undiluted' and as such it appears that BOD and SS exceeded the required limits. However, Council's CWMS water is blended with BIL's River Murray water supply and so it is expected the blended water would be below the limits. This would not be the case for E coli in the March sample, where a very high count was observed. Council advised this was because of a period of no supply / no flow at the time of the sample. We anticipate the E coli count dropped below the limit once flow began again.		
Were there any system upgrades or alterations this reporting period?		No		
Are there any upgrades or alterations planned for the next 12 months?		No		
Wastewater incidents				

OFFICIAL

Have there been any un-contained overflows or spills of wastewater or recycled water in the reporting period?	No
Incident details:	

Date Submitted:
20/09/2021

Minister for Health
C/- Wastewater Management Section
SA Health
By: Web portal

20 September 2021

Barossa Infrastructure Ltd Recycled Water Irrigation Scheme
2020/21 Annual Audit – Supplementary Information

Barossa Infrastructure Ltd (BIL) supplies water to viticulturalists in the Barossa Valley for supplementary irrigation.

BIL's primary water source is SA Water's Warren Reservoir, which is supplemented with River Murray water via SA Water's Mannum-Adelaide pipeline. In this way raw water is delivered to BIL's infrastructure near Williamstown. At SA Water's discretion, SA Water can also choose to supply BIL chloraminated water via the Swan Reach-Stockwell pipeline, connecting to BIL at the same Williamstown location. Refer to Figure 1.

BIL also receives treated CWMS water from Barossa Council, which is blended with River Murray water and supplied to a limited number of customers from BIL's Gomersal Rd pipeline. Refer to Figure 1. CWMS water represents approximately 2.5% of BIL's total water supply. The blended water supply on Gomersal Rd is the subject of this annual audit.

BIL utilised SA Health's web portal to enter and upload the minimum required information. In some instances the web portal's format does not accommodate BIL's situation. This supplement provides additional context and information.

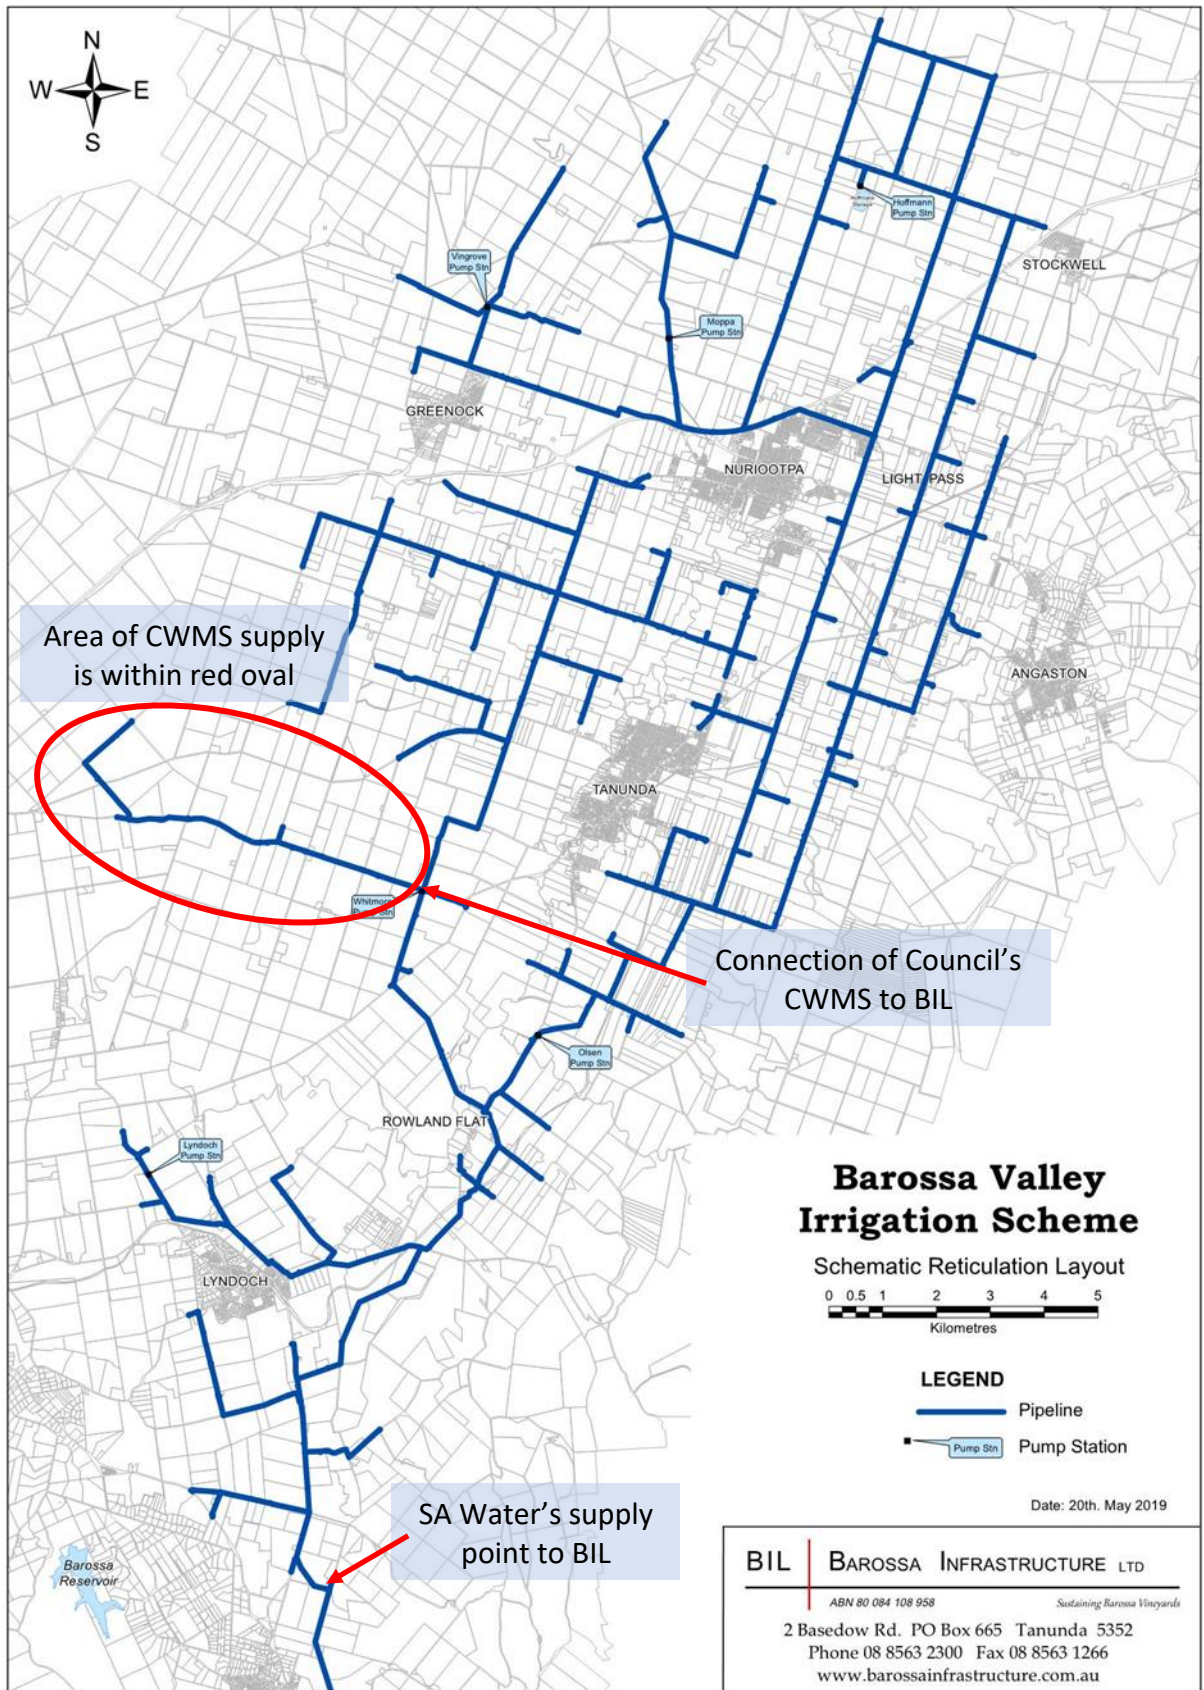


Figure 1. BIL's Pipeline Network, showing location of source waters and area of CWMS supply

Responsibility

Barossa Council are responsible for the treatment of the CWMS water and for supplying it to BIL's pipeline under pressure at the corner of Gomersal Rd and Fromm Rd.

BIL supplies the blended CWMS/River Murray water to some of its customers. BIL's system is operated and maintained by Infrastructure Maintenance Services. Other specialist contractors are used as and when required.

Water Quality Monitoring

Council provides BIL its monthly sampling data. Refer Table 1.

BIL takes an additional sample annually at the same location and tests for some additional parameters. Refer Attachment 1.

The data in Table 1 and 2 is undiluted. Dilution varies throughout the year and is summarised in Table 2.

BIL's SA Health approval specifically calls out BOD, SS and E coli as key parameters. BIL has not historically tested for BOD, SS and E Coli in the River Murray water supply and so cannot calculate the concentration of these parameters once diluted.

(These parameters will be added to our quarterly River Murray sampling regime, and so in future years the diluted concentration will be able to be estimated/calculated.)

	All Customers. Total Water Use.	All Customers. CWMS Water Use Only.		All Customers. River Murray Water Use Only.	
	(ML)	(ML)	(%)	(ML)	(%)
Jul-20	39.4	21.3	54%	18.1	46%
Aug-20	96.5	12.9	13%	83.6	87%
Sep-20	163.8	25	15%	138.8	85%
Oct-20	63.7	26.4	41%	37.3	59%
Nov-20	231.2	39.4	17%	191.8	83%
Dec-20	356.9	23.4	7%	333.5	93%
Jan-21	525.2	28.3	5%	496.9	95%
Feb-21	438.5	24.7	6%	413.8	94%
Mar-21	149	25.3	17%	123.7	83%
Apr-21	59.3	18.3	31%	41	69%
May-21	47.1	34.2	73%	12.9	27%
Jun-21	62.9	31	49%	31.9	51%
TOTAL VOLUME	2233.5	310.2	14%	1923.3	86%

Table 1 - Council Provided Monthly Sampling Data

Copy / Paste from Council's Annual Suite of Testing Tested at BIL's Supply Point - <u>Undiluted</u>																			
Date	Ammonia as N	BOD	Ca	COD	Conductivity	E. coli	Grease & Oil	Mg	N+N as N	Nitrate as N	Nitrite as N	pH	Phos. Total	Sodium	Sodium AR	Suspended S	Temp for pH	TKN as N	Total DS
	mg/L	mg/L	mg/L	mg/L	uScm	100mL	mg/L	mg/L	mg/L	mg/L	mg/L	Units	mg/L	mg/L	mg/L	mg/L	Deg C	mg/L	mg/L
16/06/2020	21.2	6	19	91	875	0	2	8.04	7.66	3.17	4.49	7.2	9.61	93	4.51	8	22.4	31.5	485
21/07/2020	30.4	15	20.6	82	981	0	2	9.51	0.92	0.68	0.24	7.2	9.66	104	4.76	18	22.8	32.6	544
18/08/2020	31.4	20	20	82	969	0	2	8.75	0.14	0.06	0.08	7.2	9.38	93.7	4.4	13	22.3	35.9	537
15/09/2020	38.5	17	24.7	134	1220	0	<1	13.4	0.51	0.06	0.45	7.3	8.57	121	4.87	14	21.7	46.5	678
20/10/2020	31.1	<2	27.4	90	1240	1	<1	15.1	1.94	0.85	1.09	7.2	9.89	129	4.91	30	21.7	32.6	689
24/11/2020	32.3	50	29	125	1320	4	<1	15.1	0.1	0.02	0.08	7.4	11.5	139	5.21	39	22.2	41	733
22/12/2020	17.1	16	27.3	134	1040	0	<1	15	0.25	0.14	0.11	7.3	10.9	122	4.66	32	22	19.5	577
19/01/2021	13	8	23.3	75	888	0	<1	9.98	<0.06	<0.06	<0.06	7.3	12.8	102	4.46	17	22.3	19.1	492
16/02/2021	10.4	6	22.7	91	834	1	<1	8.67	1.41	1.35	<0.06	7.2	12.4	95.4	4.32	14	22.1	18.8	462
16/03/2021	10.1	25	21.7	131	912	1200	<1	8.56	15.18	5.94	9.24	7.2	13	106	4.88	33	23	19	506
14/04/2021	8.8	24	21.9	126	846	12	1	8.4	12.11	2.23	9.88	7.1	11.7	95.3	4.39	34	21.9	15.9	469
11/05/2021	6.85	9	21.5	106	829	14	<1	8.13	10.84	4.37	6.47	7.1	10.9	98.5	4.59	17	20.4	11.9	459
16/06/2021	7.47	8	20.8	111	878	0	<1	8.29	12.47	7.69	4.78	7.1	12.4	102	4.78	22	20.6	18.4	487

Date	E.coli	Aluminium - Total	Arsenic - Total	Beryllium - Total	Boron - Soluble	Cadmium - Total	Calcium	Chromium - Total	Cobalt - Total	Copper - Total	Iron - Total	Lead - Total	Lithium - Total	Magnesium	Manganese - Total	Mercury - Total	Molybdenum - Total	Nickel - Total	Selenium - Total
	MPN/100ml	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L
21/07/2020	0	0.107	0.0007	<0.0003	0.087	<0.0001	20.6	0.001	0.0003	0.0139	0.1394	0.0007	0.0062	9.51	0.0387	0.00003	0.0006	0.0025	0.0004

Date	SAR - Calculation	Sodium	Uranium - Total	Vanadium - Total	Zinc - Total	Ammonia as N	Flouride	N + N as N	Nitrate as N	Grease and Oil	BOD	COD	Conductivity	TSD (by EC)	pH	Temp at pH measurement	Phosphorus - Total	SS	TKN as N
		mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	mg/L	µg/L	mg/L	pH units	degC	mg/L	mg/L	mg/L
21/07/2020	4.76	104	<0.0001	0.0004	0.0678	30.4	0.8	0.92	0.68	2	15	82	981	544	7.2	22.8	9.66	18	32.6

Attachment 1 – BIL’s CWMS Water Quality Sampling Results



Barossa Infrastructure Ltd
ATTN: Simon Schutz
PO Box 665
TANUNDA
SA 5352 AUSTRALIA

09/08/2021

Dear Simon

Please find attached the Final Analytical Report for

Customer Service Request: 122622-2021-CSR-1
Account: 122622
Project: AWQC-160509 Barossa Infrastructure Ltd - Routine 21/22

This report has also been sent to: Neville Skipworth

AWQC Sample Receipt hours are Monday and Tuesday 8:30am to 8pm and Wednesday, Thursday and Friday 8:30am to 4:30pm.

Yours sincerely,

Jason Cutler
Customer Service Officer
Jason.Cutler@sawater.com.au





FINAL REPORT: 316768

This report shall not be reproduced, except in full without the written permission of the laboratory.

Analytical Results

Sampling Point	921120-Barossa Infrastructure CWMS Supply cnr Gomersal and Fromm Rd Tanunda
Sampled Date	26/07/2021 9:54:46AM
Sample Received Date	26/07/2021 9:54:46AM
Sample Analysis Completed	5/08/2021 11:42:58AM
Sample ID	*2021-005-8324
Status	Endorsed
Collection Type	AWQC Collected

Bacteriology	LOR	Result	Test Start Date
<i>Sample temperature at time of receipt NA</i>			
E.coli & Thermotolerant Coliforms T0081-01 WMZ-500(ADEL)			26/07/2021
E.coli		0 cfu/100mL	
Thermotolerant Coliforms		10000 cfu/100mL	

Inorganic Chemistry - Metals	LOR	Result	Test Start Date
<i>Sample temperature at time of receipt NA</i>			
Arsenic - Total TIC-006 W09-023(ADEL)			27/07/2021
Arsenic - Total	0.0003	0.0006 mg/L	
Boron - Soluble TIC-006 W09-023(ADEL)			27/07/2021
Boron - Soluble	0.020	0.073 mg/L	
Cadmium - Total TIC-006 W09-023(ADEL)			27/07/2021
Cadmium - Total	0.0001	<0.0001 mg/L	
Calcium TIC-004 W09-023(ADEL)			27/07/2021
Calcium	0.1	19.9 mg/L	
Chromium - Total TIC-006 W09-023(ADEL)			27/07/2021
Chromium - Total	0.0001	0.0009 mg/L	
Iron - Total TIC-006 W09-023(ADEL)			27/07/2021
Iron - Total	0.0005	0.1677 mg/L	
Lead - Total TIC-006 W09-023(ADEL)			27/07/2021
Lead - Total	0.0001	0.0007 mg/L	
Magnesium TIC-004 W09-023(ADEL)			27/07/2021
Magnesium	0.05	8.03 mg/L	
Manganese - Total TIC-006 W09-023(ADEL)			27/07/2021
Manganese - Total	0.0001	0.0376 mg/L	
Potassium TIC-004 W09-023(ADEL)			27/07/2021
Potassium	0.05	28.4 mg/L	
Sodium Adsorption Ratio TMZ-M06 W09-023(ADEL)			26/07/2021



Corporate Accreditation
No.1115 Chemical and
Biological Testing
Accredited for compliance
with ISO/IEC 17025 -
Testing

WORLD RECOGNISED
ACCREDITATION



FINAL REPORT: 316768

This report shall not be reproduced, except in full without the written permission of the laboratory.

Analytical Results

Sampling Point	921120-Barossa Infrastructure CWMS Supply cnr Gomersal and Fromm Rd Tanunda		
Sampled Date	26/07/2021	9:54:46AM	
Sample Received Date	26/07/2021	9:54:46AM	
Sample Analysis Completed	5/08/2021	11:42:58AM	
Sample ID	*2021-005-8324		
Status	Endorsed		
Collection Type	AWQC Collected		

Sodium Adsorption Ratio TMZ-M06 W09-023(ADEL)			26/07/2021
Sodium Adsorption Ratio - Calculation	4.76		
Sodium TIC-004 W09-023(ADEL)			27/07/2021
Sodium	0.1	99.5 mg/L	
Sulphur TIC-004 W09-023(ADEL)			27/07/2021
Sulphate	1.5	44.4 mg/L	
Sulphur	0.5	14.8 mg/L	
Total Hardness as CaCO3 TMZ-M06 W09-023(ADEL)			26/07/2021
Total Hardness as CaCO3	2.0	83 mg/L	
Zinc - Total TIC-006 W09-023(ADEL)			27/07/2021
Zinc - Total	0.0003	0.0620 mg/L	

Inorganic Chemistry - Nutrients	LOR	Result	Test Start Date
<i>Sample temperature at time of receipt NA</i>			
Chloride T0104-02 W09-023(ADEL)			27/07/2021
Chloride	4.0	111 mg/L	
Nitrate + Nitrite as N T0161-01 W09-023(ADEL)			04/08/2021
Nitrate + Nitrite as N	0.003	11.0 mg/L	
Nitrogen - Total TMZ-M06 W09-023(ADEL)			26/07/2021
Nitrogen - Total		31.80 mg/L	
Phosphorus - Total T0109-01 W09-023(ADEL)			03/08/2021
Phosphorus - Total	0.005	11.1 mg/L	
TKN as N T0112-01 W09-023(ADEL)			03/08/2021
TKN as Nitrogen	0.05	20.8 mg/L	

Inorganic Chemistry - Physical	LOR	Result	Test Start Date
<i>Sample temperature at time of receipt NA</i>			
Conductivity & Total Dissolved Solids T0016-01 W09-023(ADEL)			27/07/2021
Conductivity	2	910 µS/cm	



Corporate Accreditation
No.1115 Chemical and
Biological Testing
Accredited for compliance
with ISO/IEC 17025 -
Testing

WORLD RECOGNISED
ACCREDITATION



FINAL REPORT: 316768

This report shall not be reproduced, except in full without the written permission of the laboratory.

Analytical Results

Sampling Point	921120-Barossa Infrastructure CWMS Supply cnr Gomersal and Fromm Rd Tanunda
Sampled Date	26/07/2021 9:54:46AM
Sample Received Date	26/07/2021 9:54:46AM
Sample Analysis Completed	5/08/2021 11:42:58AM
Sample ID	*2021-005-8324
Status	Endorsed
Collection Type	AWQC Collected

Conductivity & Total Dissolved Solids T0016-01 W09-023(ADEL)		27/07/2021
Total Dissolved Solids (by EC)	1	505 mg/L
pH T0010-01 W09-023(ADEL)		27/07/2021
pH		7.2 pH units
Temperature at which pH is measured		22.3 °C
Turbidity T0018-01 W09-023(ADEL)		26/07/2021
Turbidity	0.1	20 NTU

Sampling	LOR	Result	Test Start Date
Sample temperature at time of receipt NA			
Chlorine T0012-01 W09-023(ADEL)			26/07/2021
Chlorine - Free	0.1	<0.1 mg/L	
Chlorine - Total	0.1	<0.1 mg/L	
Monochloramine	0.1	<0.1 mg/L	



Corporate Accreditation
No.1115 Chemical and
Biological Testing
Accredited for compliance
with ISO/IEC 17025 -
Testing



FINAL REPORT: 316768

This report shall not be reproduced, except in full without the written permission of the laboratory.

AWQC Signatories

Mira Banasiak - Supervisor Bacteriology and Molecular Testing Services

Dzung Bui - Supervisor Metals and Physical

Ivana Cech - Technical Officer Chemistry

Vickie Dalglish - Senior Technical Officer Bacteriology & Molecular Testing

Thuy Diep - Technical Officer Chemistry

David Evans - Technical Officer Chemistry

Andrew Ford - Senior Technical Officer Chemistry

Aji John - Technical Officer Chemistry

Chami Karunatilaka - Technical Officer Chemistry

Brendan Walsh - Senior Field Officer



Corporate Accreditation
No.1115 Chemical and
Biological Testing
Accredited for compliance
with ISO/IEC 17025 -
Testing

WORLD RECOGNISED
ACCREDITATION



FINAL REPORT: 316768

This report shall not be reproduced, except in full without the written permission of the laboratory.

Incidents

Sample ID	S.Point	Description	Sampled Date	Analysis (where Applicable)	Incident Description
2021-005-8323	84513	Barossa Infrastructure Ltd - Fromms Square Williamstown	16/07/2021	pH	Test not processed within holding time
2021-005-8323	84513	Barossa Infrastructure Ltd - Fromms Square Williamstown	16/07/2021	Turbidity	Test not processed within holding time
2021-005-8324	921120	Barossa Infrastructure CWMS Supply cnr Gomersal and Fromm Rd Tanunda	26/07/2021	pH	Test not processed within holding time

Analytical Method

Analytical Method Code	Description	Reference Method
W-052	Preparation of Samples for Metal Analysis	AP3030AD
TMZ-M06	Derived Results and Data Checks	
T0104-02	Chloride - Discrete Analyser	AP4500CLE
T0018-01	Turbidity - Nephelometric Measurement	APAWWA-WEF
TMZ-M06	Derived Results and Data Checks	AP4500NORGA
T0109-01	Phosphorus - total by discrete analyser	AP4500PF
T0081-01	E. coli - Membrane filtration	USEPA1604_1H
T0012-01	Chlorine by classical and portable meter (field test)	AP4500CLF
T0112-01	Nitrogen- Total Kjeldahl by discrete analyser	AP4500NORGA
TMZ-M06	Derived Results and Data Checks	APHA2340B
T0016-01	Determination of Conductivity - Corrected to 25C	AP2510B
TIC-006	Elemental Analysis By ICP- MS	EPA200.8
T0161-01	Nitrate + Nitrate (NOx) - Automated Flow Colorimetry	AP4500NO3I
T0010-01	Determination of pH	AP4500HB
TIC-004	Determination of Metals - ICP Spectrometry by ICP2	AP3120

Sampling Method

Sampling Method Code	Description
W09-023	Sampling Method for Chemical Analyses
WMZ-500	Sampling Method for Microbiological Analyses

When samples are taken by customers, samples are analysed as received.



Corporate Accreditation
No.1115 Chemical and
Biological Testing
Accredited for compliance
with ISO/IEC 17025 -
Testing



FINAL REPORT: 316768

This report shall not be reproduced, except in full without the written permission of the laboratory.

Laboratory Information

Laboratory	NATA accreditation ID
Inorganic Chemistry - Physical Sampling	1115
Inorganic Chemistry - Nutrients	1115
Bacteriology	1115
Inorganic Chemistry - Metals	1115



Corporate Accreditation
No.1115 Chemical and
Biological Testing
Accredited for compliance
with ISO/IEC 17025 -
Testing

- Notes
1. The last figure of the result value is a significant figure.
 2. # determination of the component is not covered by NATA Accreditation.
 3. ^ indicates result is out of specification according to the reference guideline. Refer to report footer.
 4. * indicates an incident has been recorded against the sample. Refer to report footer.
 5. & Indicates the results have changed since the last issued report.
 6. Where a result is required to meet compliance limits the associated measurement uncertainty must be considered. Measurement uncertainty is available at <https://www.awqc.com.au/our-services/Water-quality-testing-and-analysis/measurement-uncertainty>
 7. Uncertainty of Measurement is reported with a coverage factor of 2 providing approximately 95% confidence interval
 8. The Limit of Reporting (LOR) is the lowest concentration of analyte which is reported at the AWQC and is based on the LOQ rounded up to a more readily used value. The Limit of Quantitation (LOQ) is the lowest concentration of analyte for which quantitative results may be obtained within a specified degree of confidence.
 9. Where collection type is AWQC Collect, NATA has confirmed that due to a robust system in place for maintaining the temperature integrity for samples collected by AWQC's Field Laboratory Services, the recording of temperature when samples arrive at the AWQC is out of scope.
 10. If pH has been tested then the pH will be outside of its holding time unless measured in the field.
 11. (ADEL) indicates analysed in Adelaide, (MELB) indicates analysed in Melbourne.